


POWER-UNITS No.53A AND No.53B

10V 0.25A DC
SUPPLY FROM 50Hz AC MAINS

N 631
ISSUE E

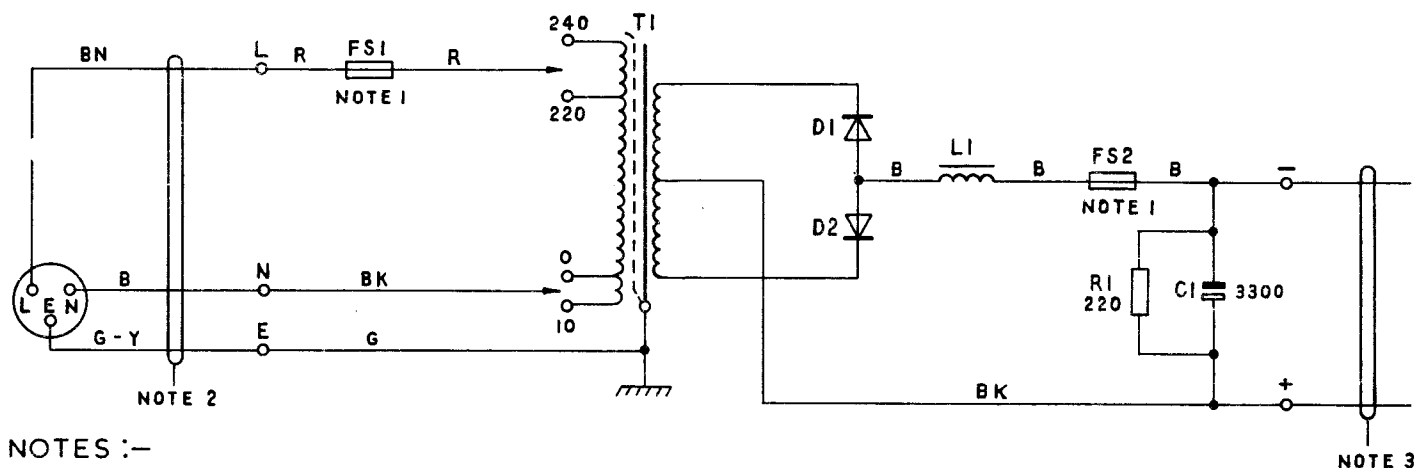

NOTES :-

1. FS1 - FUSE No.36A/0.1 FS2 - FUSE No.36/0.5
2. CORD FLEXIBLE 3183Y 0.75mm² AND BS 3 PIN PLUG TO SUIT SOCKET TO BE REQUISITIONED SEPARATELY AND FITTED LOCALLY FUSED PLUGS TO BE FITTED WITH 3 AMP FUSES
3. CABLE DISTRIBUTION 3595 REQUISITIONED SEPARATELY AND FITTED LOCALLY
4. THE OUTPUT MUST NOT BE EARTHED

PO TELECOMMS HQRS PAPER :-W DISTN :- GENERAL			
	E	NEW FORMAT. TRANSFORMER 200V TAPPING REMOVED WIRE COLOURS AND CAPACITOR VALUE CHANGED. NOTES 2&3 AMENDED. NOTE 4 ADDED. 53B INTRODUCED D.L.W. TD 7.2.3	12-4-77
	D	NEW FORMAT KMA	12-7-66